

SULPHUR SPRINGS USD

CANYON SPRINGS ES FIRE ALARM UPGRADES

DSA Submittal


03/28/25

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 03-125069 INC:
REVIEWED FOR
SS FLS ACS
DATE: 04/02/2025

PBK

CANYON SPRINGS ES FIRE ALARM UPDATES

PROJECT ADDRESS:
190590 WICCI STREET
SANTA CLARITA, CA 91351
DSA Submittal
DSA APPLN NO: 03-125069 DSA FILE NO: 19-104

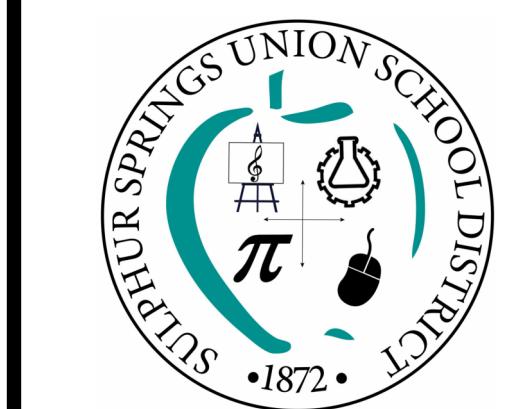

Architect
LICENSED ARCHITECT
No. C-31162
Yong Yoo
SBN: 10-31-2023
STATE OF CALIFORNIA

COVER SHEET

OWNER

Sulphur Springs USD
27000 Weyerhaeuser Way, Santa
Clarita, CA 91351
t: 661-252-3017
Contact: Ronaldo Lopez Garcia


ARCHITECT

PBK Architects
843 N Spring Street
Los Angeles, CA 90012
t: 909.987.0909
Contact: Yong Yoo

FA ENGINEER

LEAF Engineers
8163 Rochester Ave
Rancho Cucamonga, CA 91730
t: (909)-987-0909
Contact: Charles Musser

G0.00

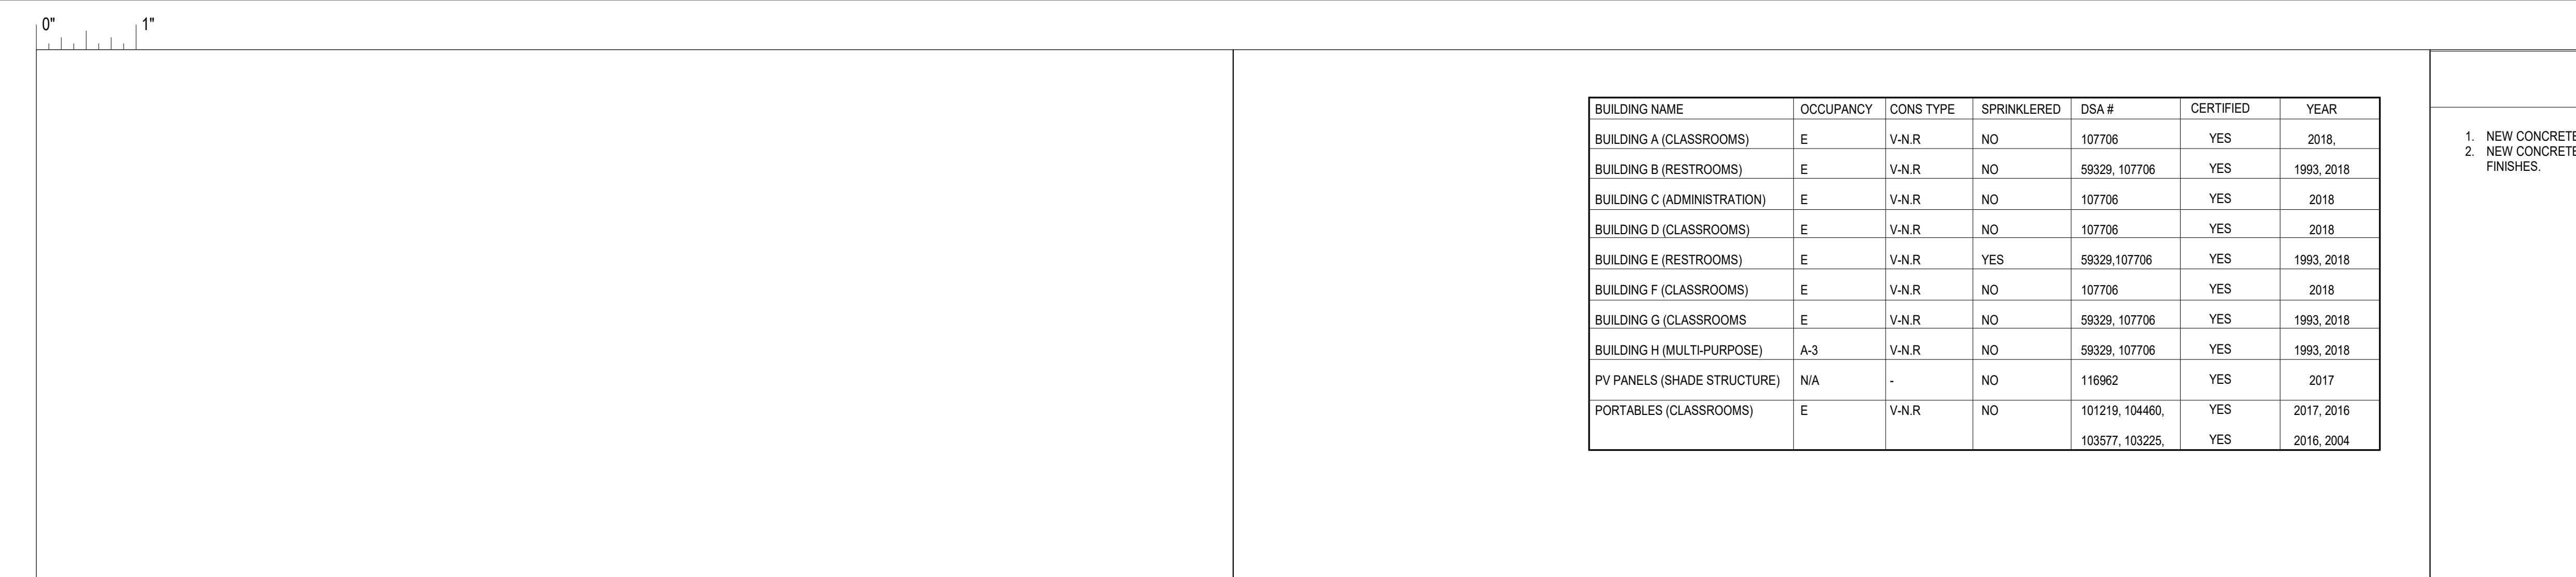

GENERAL NOTES

1. NEW CONCRETE PAVING TO MATCH EXISTING GRADES
2. NEW CONCRETE PAVING THICKNESS & BROOM FINISH TO MATCH EXISTING ADJACENT FINISHES.

CONSTRUCTION KEYED NOTES

#	Description
03.01	(N) CONCRETE PAVING, MATCH EXISTING PAVING THICKNESS & BROOM FINISH
32.01	PATCH & REPAIR EXISTING LANDSCAPE DUE TO NEW WORK

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 03-125069 INC:
REVIEWED FOR
SS FLS ACS
DATE: 04/02/2025

PRK
ARCHITECT PBK Architects, Inc.
LOS ANGELES 843 N Sepulveda Boulevard, Suite 300
Los Angeles, CA 90012
909-987-0999 P

PROJECT ADDRESS:
190590 VICCI STREET
SANTA CLARITA, CA 91351
DSA APPLN NO.: 03-125069 DSA FILE NO.: 19-104

EXISTING BUILDINGS IN SCOPE OF WORK
(FIRE ALARM ONLY)

EXISTING BUILDINGS NOT IN SCOPE OF WORK

NEW CONCRETE PATCH WORK

NEW TURF PATCH WORK

3

4

5

6

7

8

9

10

11

12

13

14

15

16

17

18

19

20

21

22

23

24

25

26

27

28

29

30

31

32

33

34

35

36

37

38

39

40

41

42

43

44

45

46

47

48

49

50

51

52

53

54

55

56

57

58

59

60

61

62

63

64

65

66

67

68

69

70

71

72

73

74

75

76

77

78

79

80

81

82

83

84

85

86

87

88

89

90

91

92

93

94

95

96

97

98

99

100

101

102

103

104

105

106

107

108

109

110

111

112

113

114

115

116

117

118

119

120

121

122

123

124

125

126

127

128

129

130

131

132

133

134

135

136

137

138

139

140

141

142

143

144

145

146

147

148

149

150

151

152

153

154

155

156

157

158

159

160

161

162

163





164

165

166

167

168

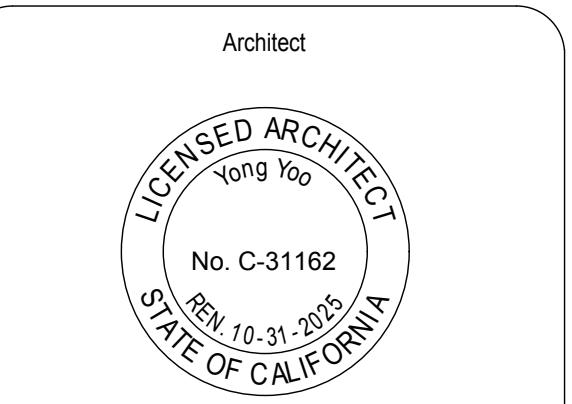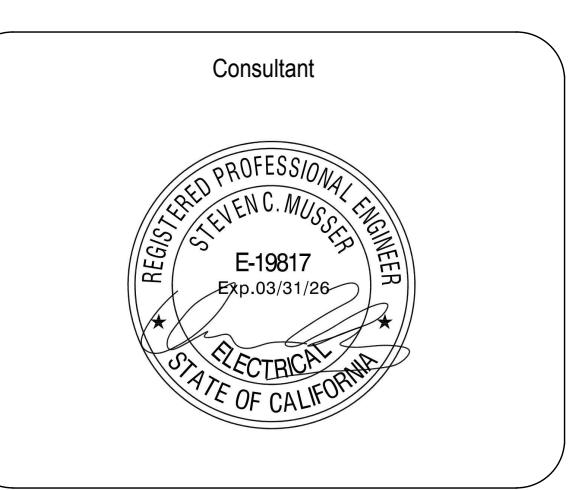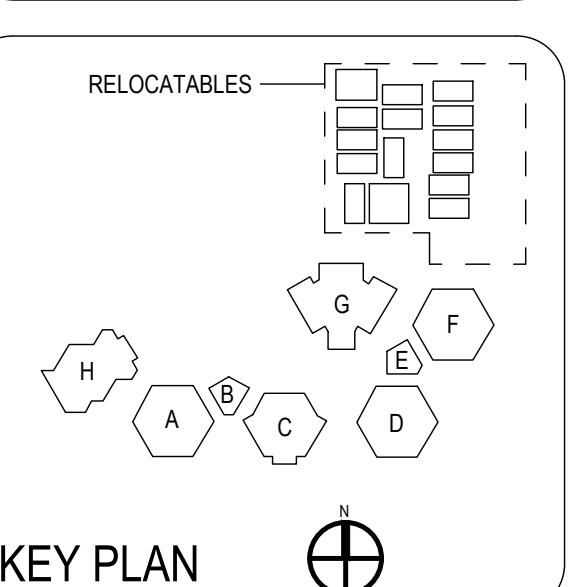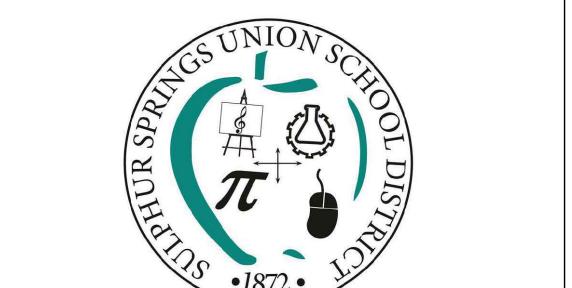


CLIENT	Sulphur Spring Union School District
DATE	3/28/25
PROJECT NUMBER	240502
REVISIONS	




No. Description Date

DSA Submittal

**FIRE ALARM
RISER DIAGRAM**

FA5.01

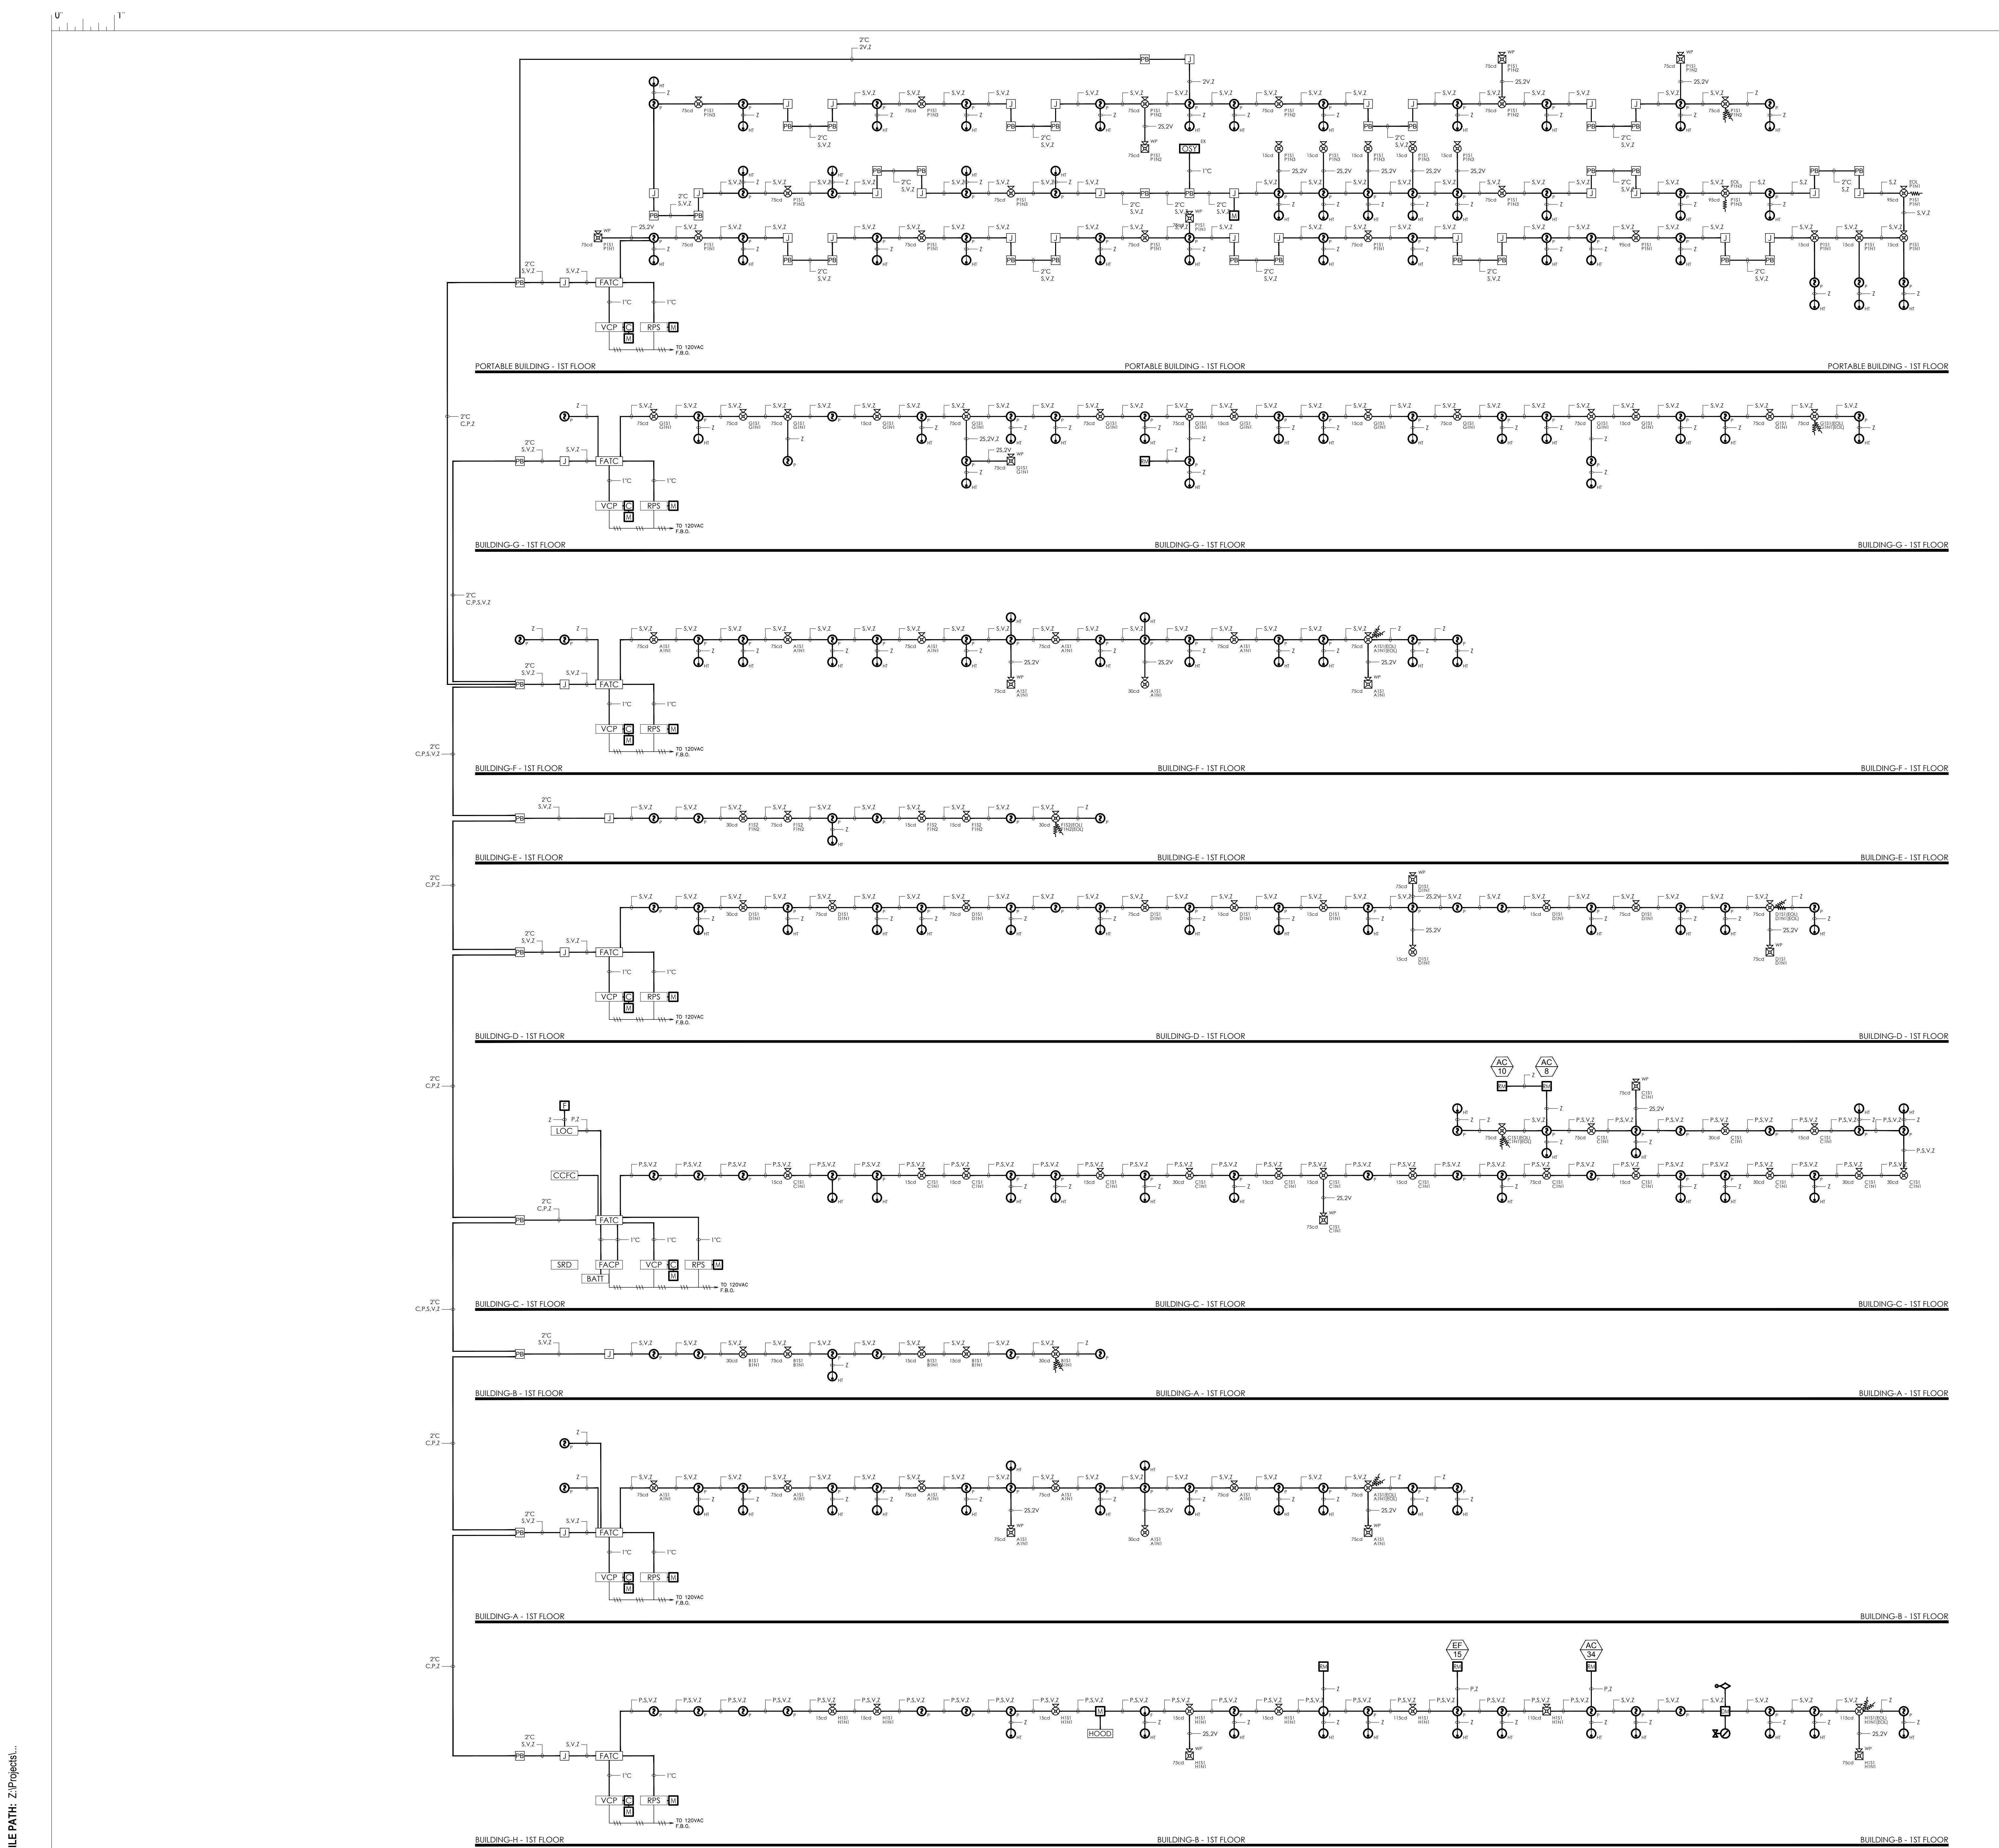

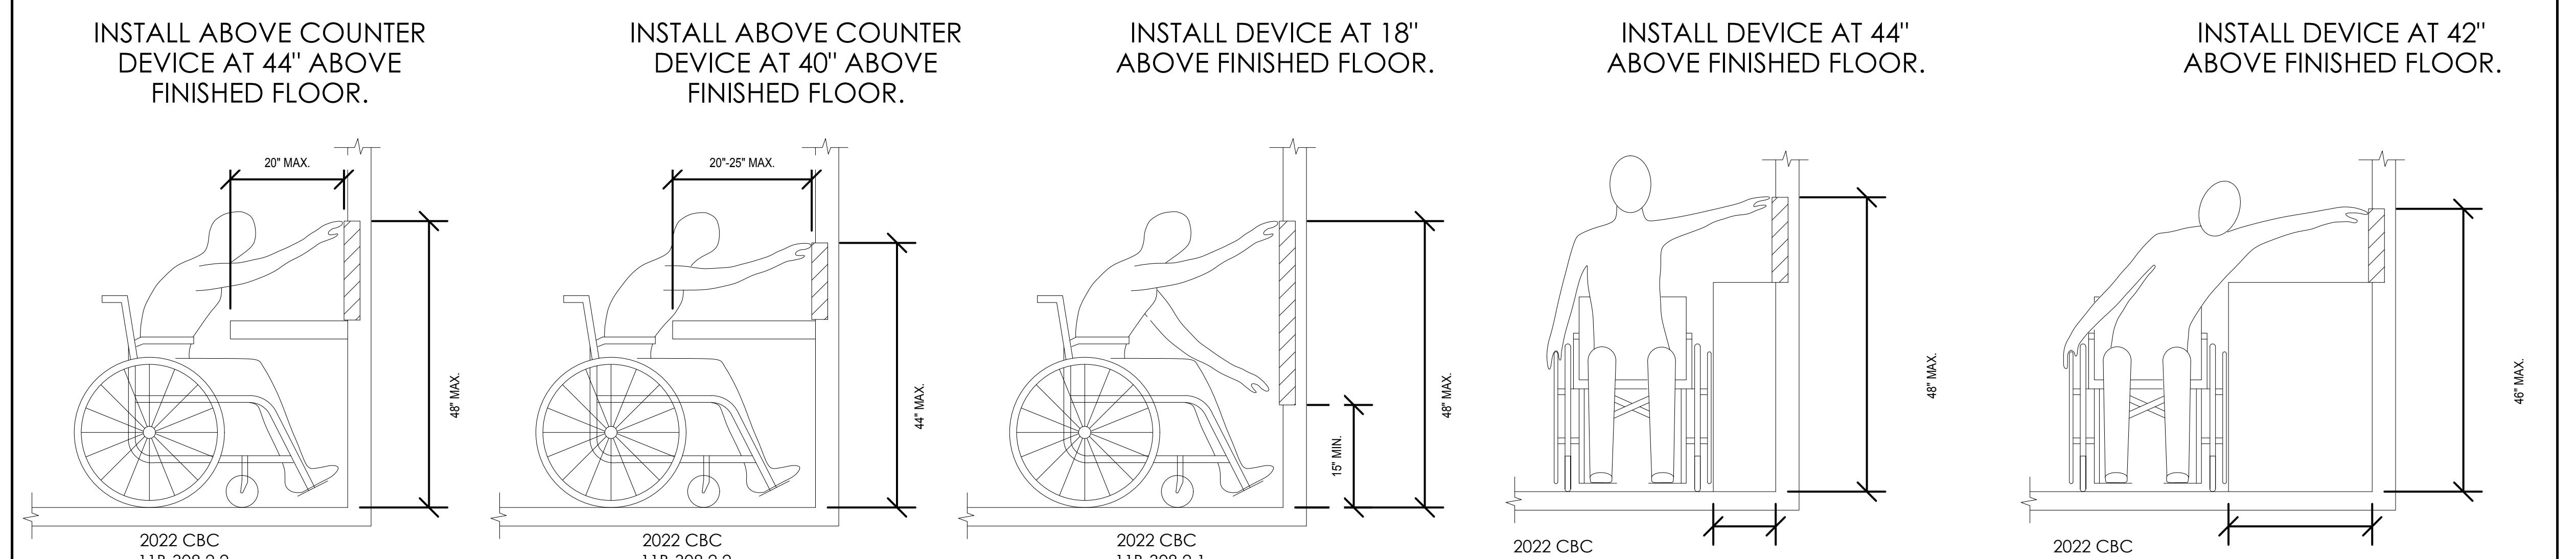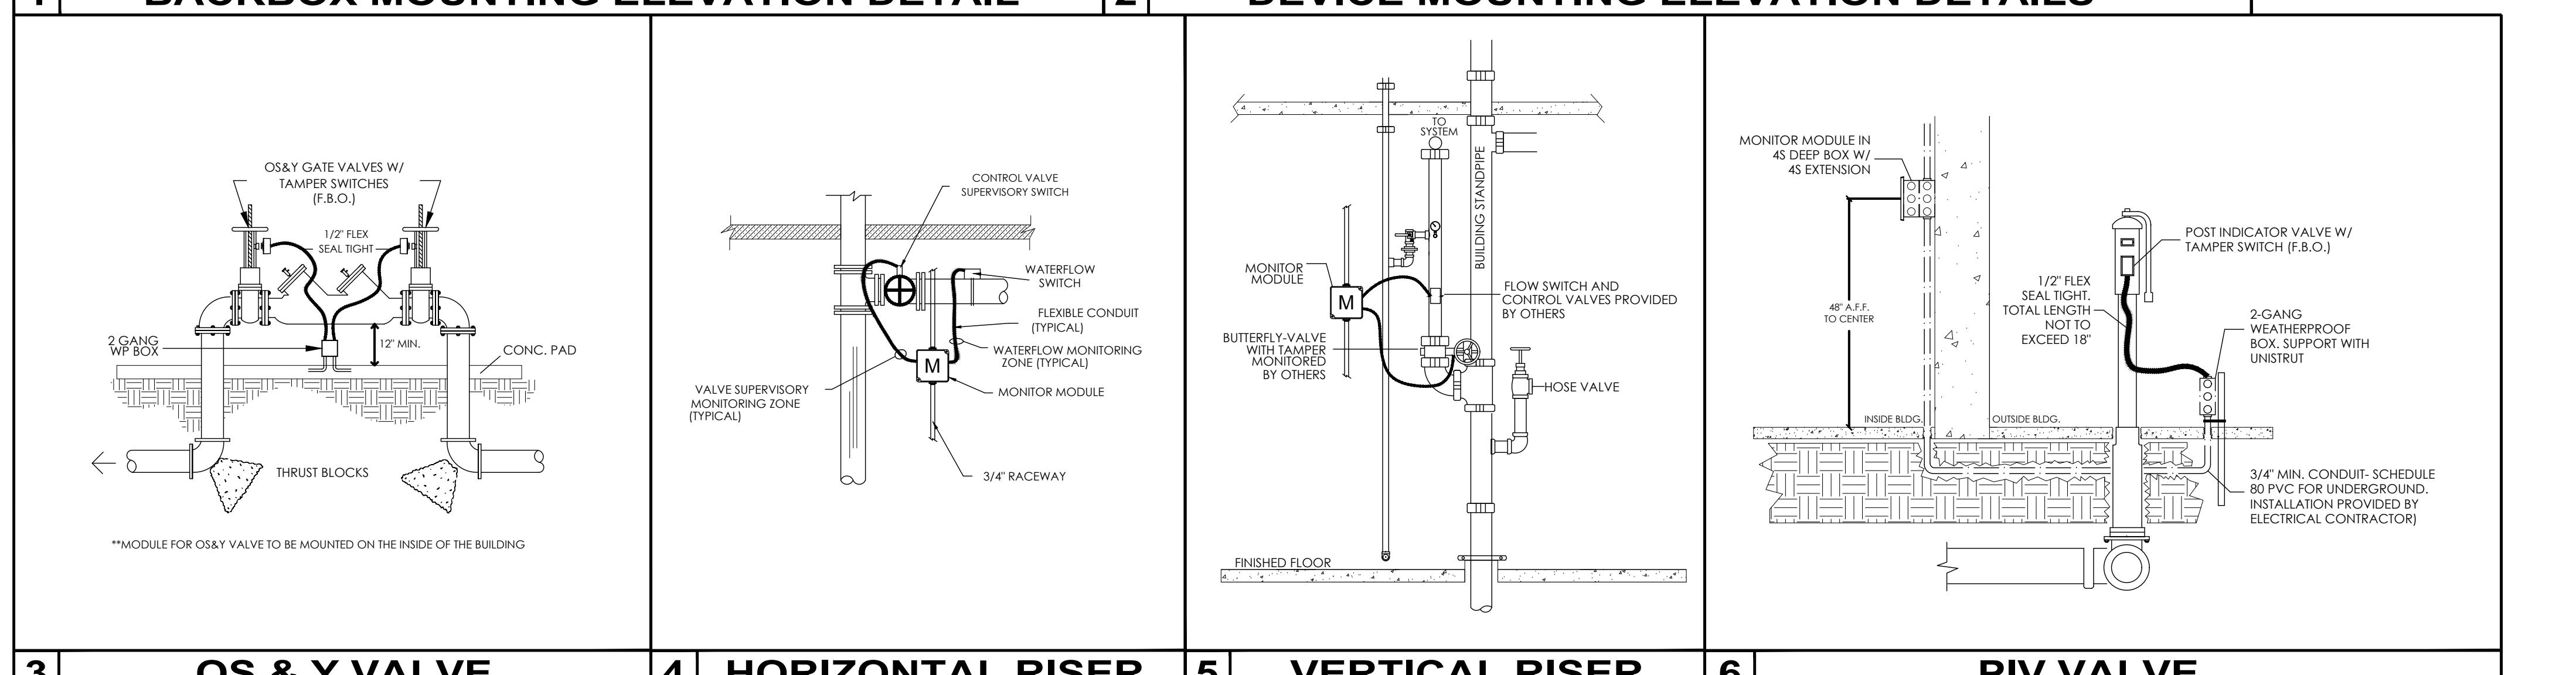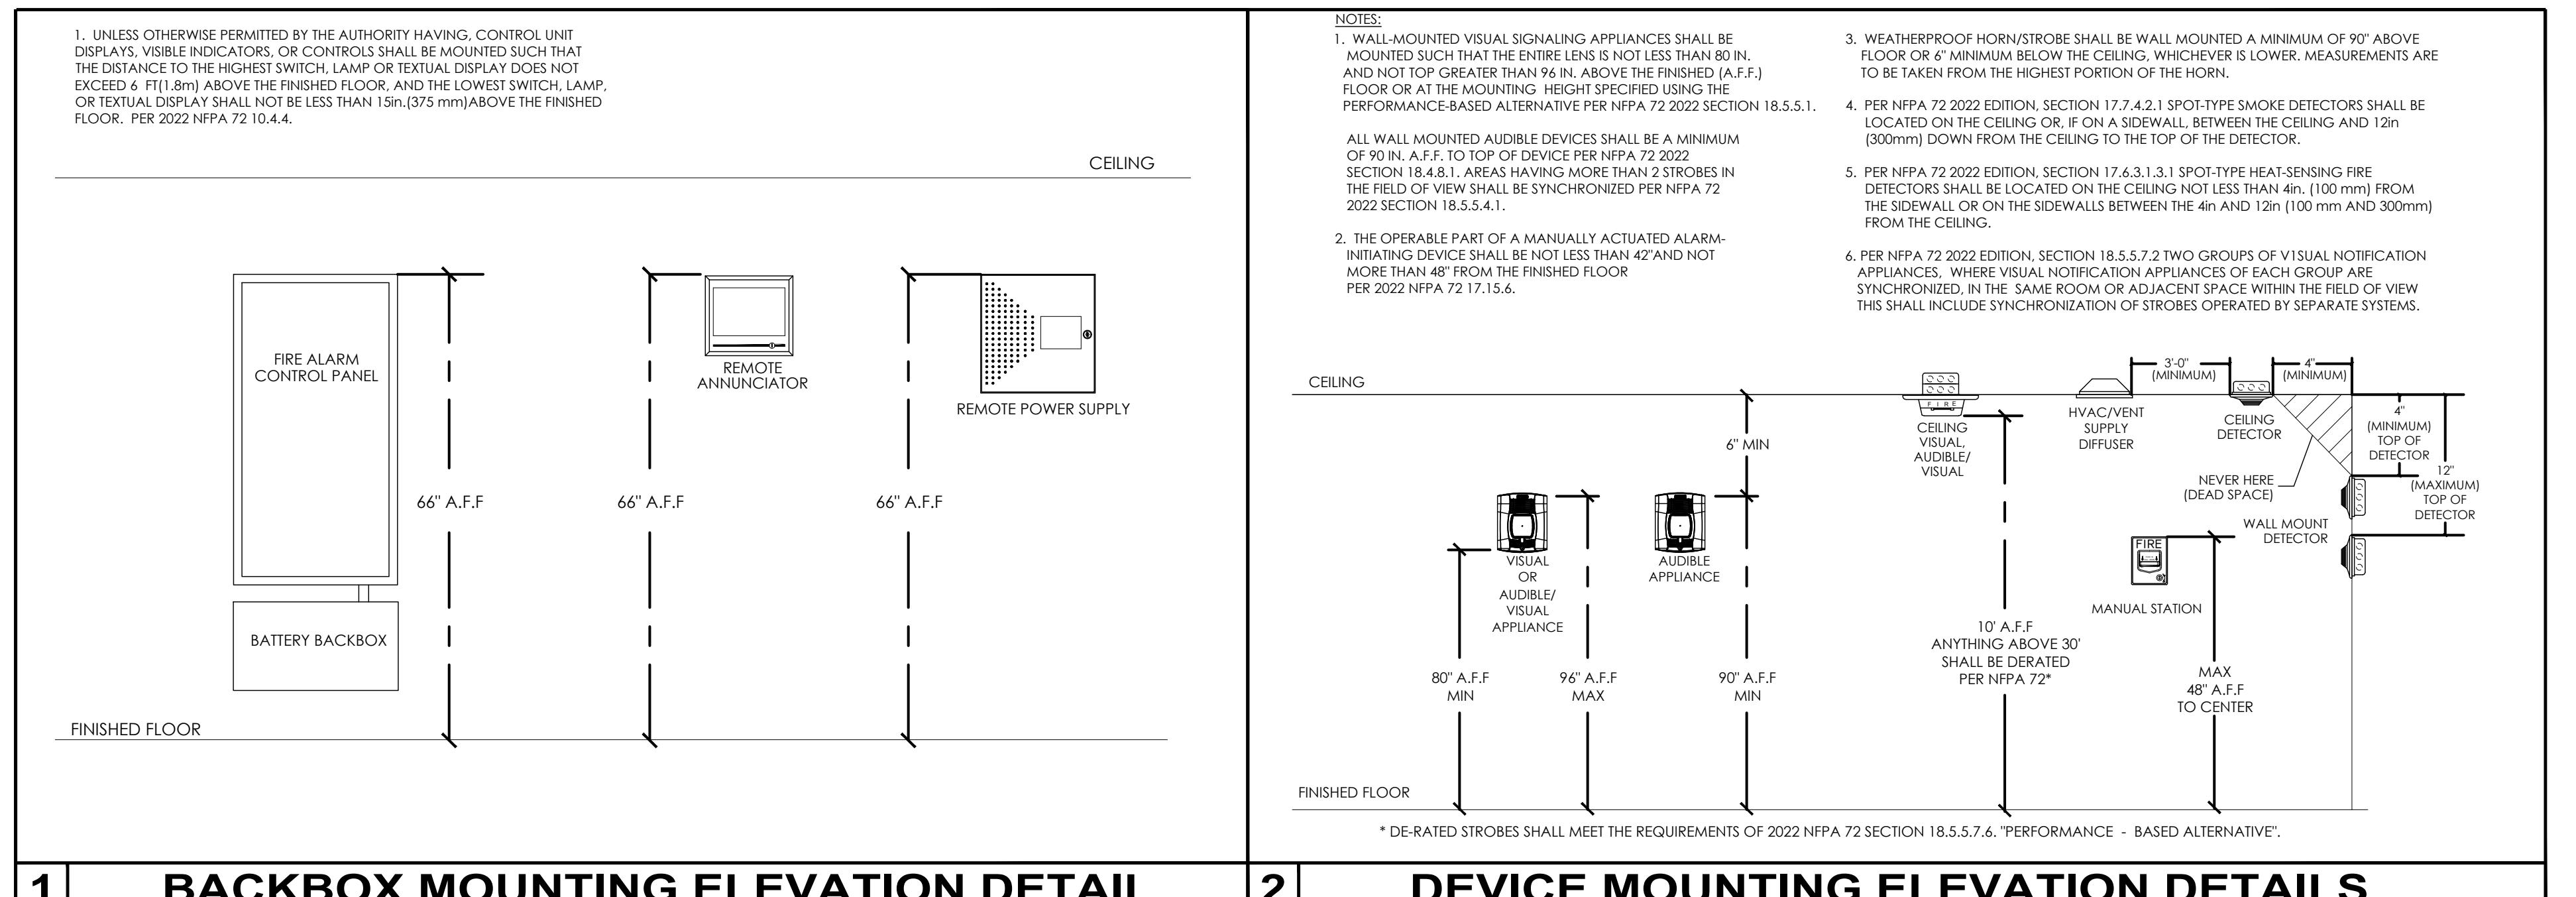


ADA GUIDELINES -FRONT ACCESS

GENERAL NOTES:


1. CONTRACTOR SHALL COORDINATE J-BOXES AT ADA REQUIRED HEIGHTS TO ALLOW FOR THE DEVICE CONTROLS TO FALL WITHIN THE ACCESSIBLE REACH RANGE SHOWN ABOVE.
2. PROVIDE INSTALLATION PER SECTION 11B-308.1.1 ELECTRICAL SWITCHES.
3. WALL PHONES, CONTROLS AND SWITCHES INTENDED TO BE USED BY THE OCCUPANT OF A ROOM OR AREA TO CONTROL LIGHTING AND RECEPTACLE OUTLETS, APPLIANCES OR COOLING, HEATING VENTILATING EQUIPMENT, SHALL COMPLY WITH SECTION 11B-308 EXCEPT THE LOW REACH SHALL BE MEASURED TO THE BOTTOM OF THE OUTLET BOX AND THE HIGH REACH SHALL BE MEASURED TO THE TOP OF THE OUTLET BOX.

ADA GUIDELINES -SIDE ACCESS

7 ADA STANDARDS FOR ACCESSIBLE DESIGN

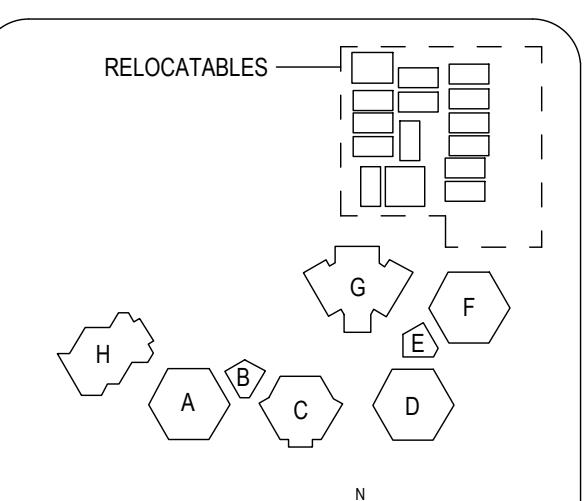

KEY PLAN

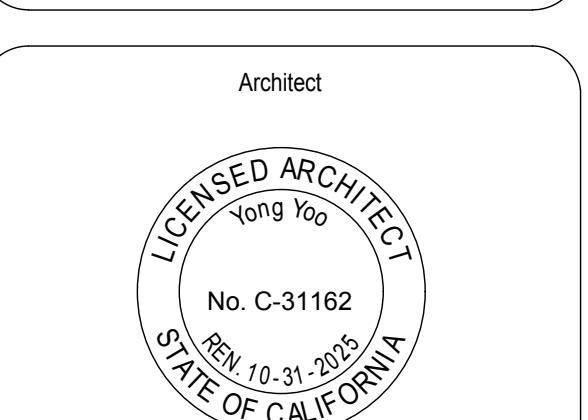

CLIENT
Sulphur Spring Union School District
DATE 3/28/25 PROJECT NUMBER 240502

REVISIONS
No. Description Date

DSA Submittal

FIRE ALARM DETAILS

